



INFORMATION BULLETIN

IB-011

Eff: 01-01-2008 Rev: 12-06-2023

Suspended Ceiling Standards

The purpose of this Informational Bulletin is to alert designers of the specific amendment the City of Long Beach has made to the 2022 California Building Code to address the lack of adequate design requirements for suspended ceiling assemblies to account for seismic loading. It is through experience gained from prior earthquakes, such as the 1994 Northridge Earthquake, that this amendment is adopted so as to minimize bodily and property damage within spaces where these type of ceiling assemblies will be installed.

When suspended ceiling assemblies are required to comply with Section 18.40.330 of the Long Beach Municipal Code, designers shall submit construction documents and calculations to the Department for review and approval prior to installation. The construction documents should clearly identify all suspended ceiling systems to be used and the locations where they will be installed. Supporting details, light fixture attachments, lateral bracing, partition supports, and all other pertinent details should be provided on the construction documents to illustrate compliance with the Code.

Section 18.40.330 of the Long Beach Municipal Code added Section 1613.6 to the 2022 California Building Code. This section of the Long Beach Municipal Code is repeated herein as follows:

18.40.330 Add CBC 1613.6 – Suspended ceiling.

Section 1613.6 is added to Chapter 16 of the 2022 California Building Code to read as follows:

1613.6 Suspended Ceilings. Minimum design and installation standards for suspended ceilings shall be determined in accordance with the requirements of Section 2506.2.1 of this Code and this Section.

1613.6.1 Scope. This part contains special requirements for suspended ceilings and lighting systems. Provisions of Section 13.5.6 of ASCE 7 shall apply except as modified herein.

1613.6.2 General. The suspended ceilings and lighting systems shall be limited to 6 feet (1,828 mm) below the structural deck unless the lateral bracing is designed by a registered design professional.

1613.6.3 Sprinkler Heads. All sprinkler heads (drops) except fire-resistance-rated floor/ceiling or roof/ceiling assemblies, shall be designed to allow for free movement of the sprinkler pipes with oversize rings, sleeves or adaptors through the ceiling tile. Sprinkler heads and other penetrations shall have a 2-inch (50 mm) oversizing ring, sleeve or adapter through the ceiling tile to allow for free movement of at least 1-inch (25 mm) in all horizontal directions. Alternatively, a swing joint that can accommodate 1-inch

(25 mm) of ceiling movement in all horizontal directions is permitted to be provided at the top of the sprinkler head extension.

Sprinkler heads penetrating fire-resistance-rated floor/ceiling or roof/ceiling assemblies shall comply with Section 714 of this code.

1613.6.4 Special Requirements for Means of Egress. Suspended ceiling assemblies located along a means of egress serving an occupant load of 30 or more and lobbies accessory to Group A Occupancies shall comply with the following provisions.


1613.6.4.1 General. Ceiling suspension systems shall be connected and braced with vertical hangers attached directly to the structural deck along the means of egress. Spacing of vertical hangers shall not exceed 2 feet (610 mm) on center along the entire length of the suspended ceiling assembly located along the means of egress or at the lobby.

1613.6.4.2 Assembly Device. All lay-in panels shall be secured to the suspension ceiling assembly with two hold-down clips minimum for each tile within a 4-foot (1219 mm) radius of the exit lights and exit signs.

1613.6.4.3 Emergency Systems. Independent supports and braces shall be provided for light fixtures required for exit illumination. Power supply for exit illumination shall comply with the requirements of Section 1008.3 of this code.

1613.6.4.4 Supports for Appendage. Separate support from the structural deck shall be provided for all appendages such as light fixtures, air diffusers, exit signs, and similar elements.


EXAMPLE OF SUSPENDED CEILING VERTICAL AND LATERAL SUPPORT

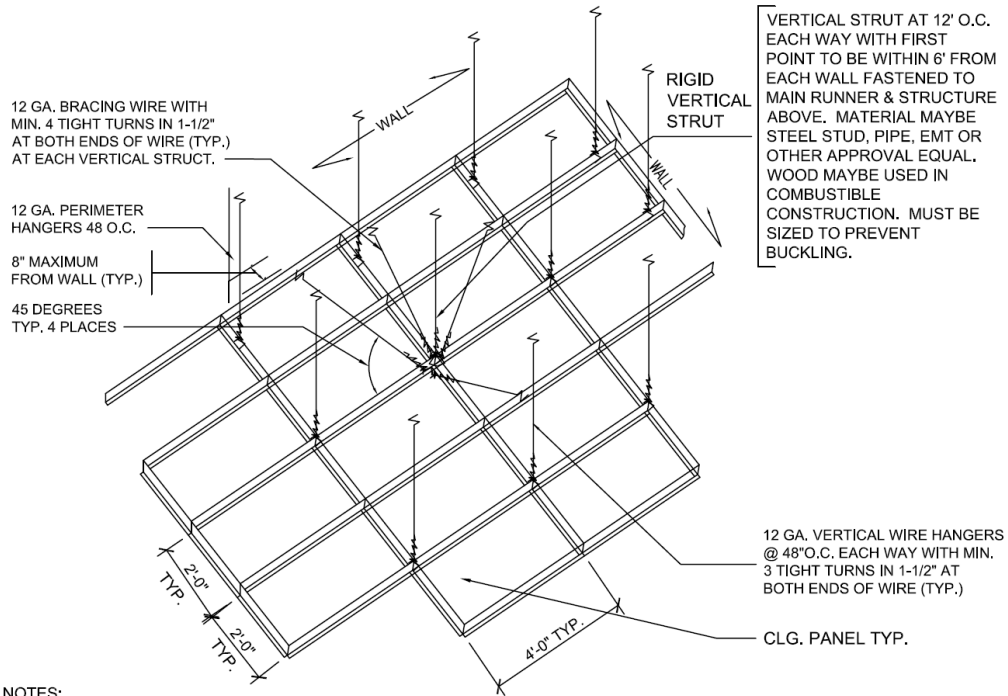

NOTES:


1. VERTICAL STRUT: A STRUT FASTENED TO THE MAIN RUNNER SHALL BE EXTENDED TO AND FASTENED TO THE STRUCTURAL MEMBERS SUPPORTING THE ROOF OR FLOOR ABOVE. THE STRUT SHALL BE ADEQUATE TO RESIST THE VERTICAL SEISMIC COMPONENT INDUCED BY THE BRACING WIRES.
2. THESE HORIZONTAL RESTRAINT POINTS SHALL BE PLACED AT 12 FEET ON CENTER IN BOTH DIRECTIONS WITH THE FIRST POINT WITHIN 6 FEET FROM THE WALL.
3. PERIMETER HANGERS SHALL BE PLACED IN BOTH DIRECTIONS WITHIN 8 INCHES OF THE WALL.
4. WHEN THE DISTANCE BETWEEN THE STRUCTURAL DECK AND THE CEILING EXCEEDS 4', THE SPACING OF THE VERTICAL HANGERS SHALL NOT EXCEED 2' O.C. ALONG THE ENTIRE LENGTH OF THE MEANS OF EGRESS SERVING AN OCCUPANT LOAD OF 30 OR MORE, AND AT LOBBIES ACCESSORY TO GROUP A OCCUPANCIES.

EXAMPLE OF SUSPENDED CEILING AT PERIMETER WALL AND INTERIOR FULL HEIGHT PARTITION

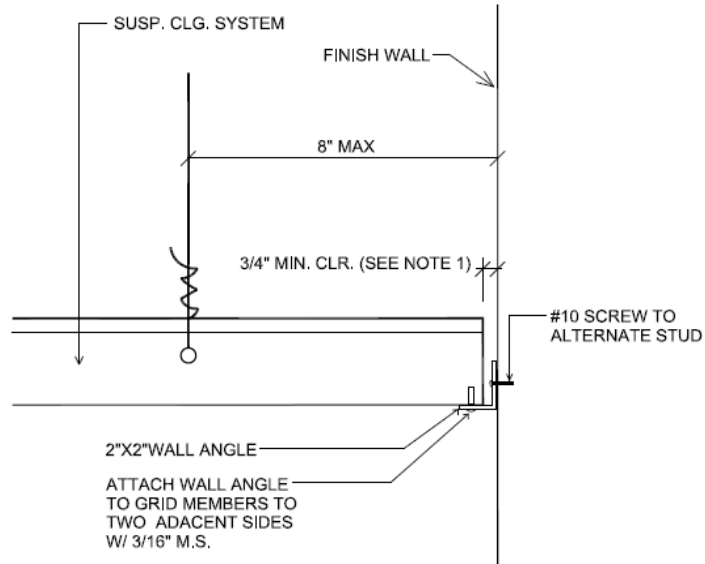

NOTES:
 1. A MINIMUM WALL ANGLE SIZE OF AT LEAST 2" HORIZONTAL LEG SHALL BE USED AT PERIMETER WALLS AND INTERIOR FULL HEIGHT PARTITION. THE FIRST TILE SHALL BE 3/4" CLEAR FROM WALL SURFACE.

EXAMPLE OF SUSPENDED CEILING LIGHT FIXTURE ATTACHMENT

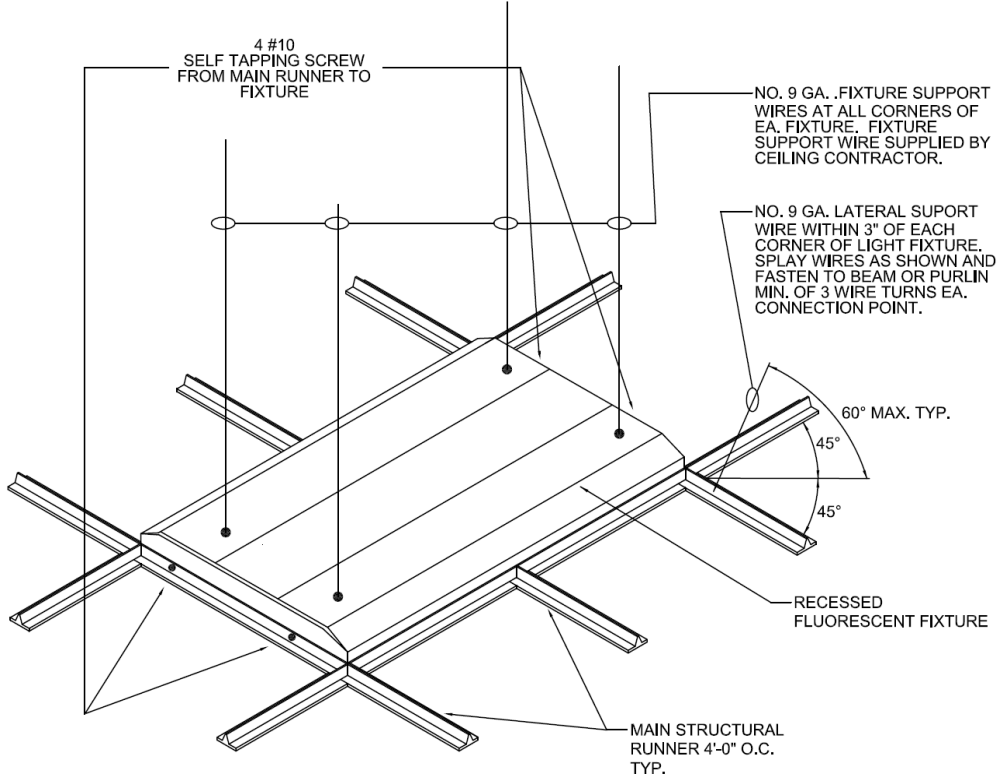

To request this information in an alternative format or to request a reasonable accommodation, please contact the Community Development Department at longbeach.gov/lbcd and 562.570.3807. A minimum of three business days is requested to ensure availability; attempts will be made to accommodate requests with shorter notice.